

CONTROL LOOP DIAGRAM
FOR TRANSFER LINE

FOR APPROVAL	
01	
02	
03	
04	
05	
06	
07	
08	
09	
10	
11	
12	
13	
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	
31	
32	
33	
34	
35	
36	
37	
38	
39	
40	
41	
42	
43	
44	
45	
46	
47	
48	
49	
50	
51	
52	
53	
54	
55	
56	
57	
58	
59	
60	
61	
62	
63	
64	
65	
66	
67	
68	
69	
70	
71	
72	
73	
74	
75	
76	
77	
78	
79	
80	
81	
82	
83	
84	
85	
86	
87	
88	
89	
90	
91	
92	
93	
94	
95	
96	
97	
98	
99	
100	

BARSOO G.I.S.D.Co

CONTROL LOOP DIAGRAM FOR TRANSFER LINE

157DAIGU2070002-01


Document Revision


Page	A1	01	02	03	04	05	06	07	Page	A1	01	02	03	04	05	06	07
1	X	X	X						41								
2	X	X	X						42								
3	X	X	X						43								
4	X	X	X						44								
5	X	X	X						45								
6	X	X	X						46								
7	X	X	X						47								
8	X	X	X						48								
9	X	X	X						49								
10	X	X	X						50								
11	X	X	X						51								
12		X	X						52								
13		X	X						53								
14			X						54								
15									55								
16									56								
17									57								
18									58								
19									59								
20									60								
21									61								
22									62								
23									63								
24									64								
25									65								
26									66								
27									67								
28									68								
29									69								
30									70								
31									71								
32									72								
33									73								
34									74								
35									75								
36									76								
37									77								
38									78								
39									79								
40									80								

NOTE:

Address of Cards, Slot, Channels, Terminals, and etc. will be finalized by vendor.


[illegible]

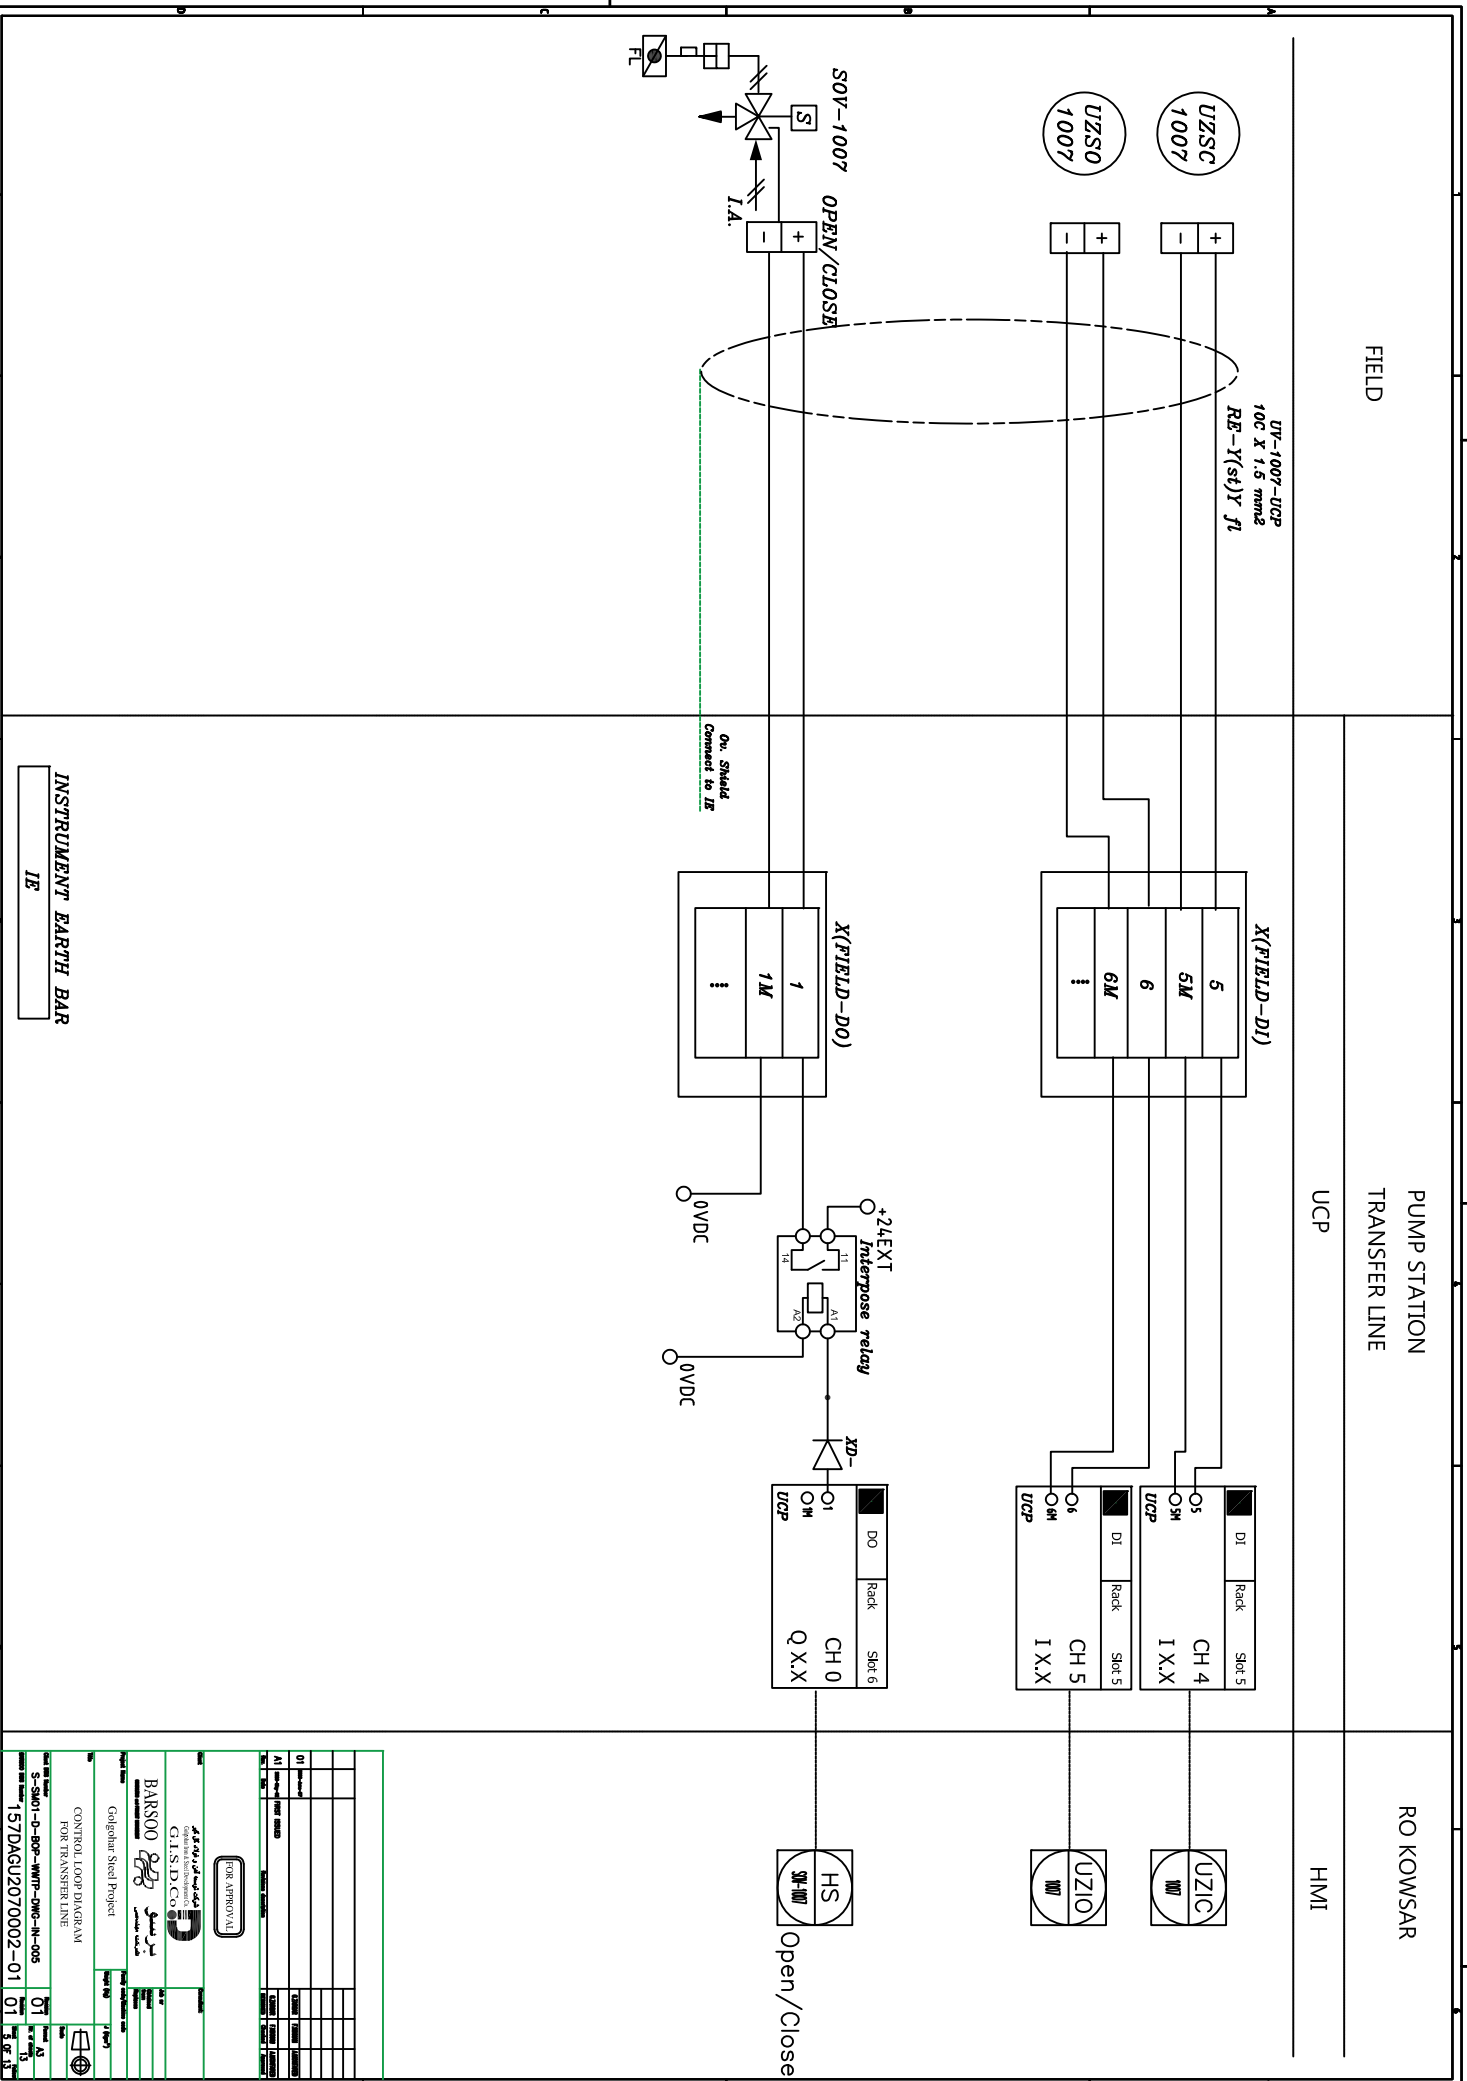

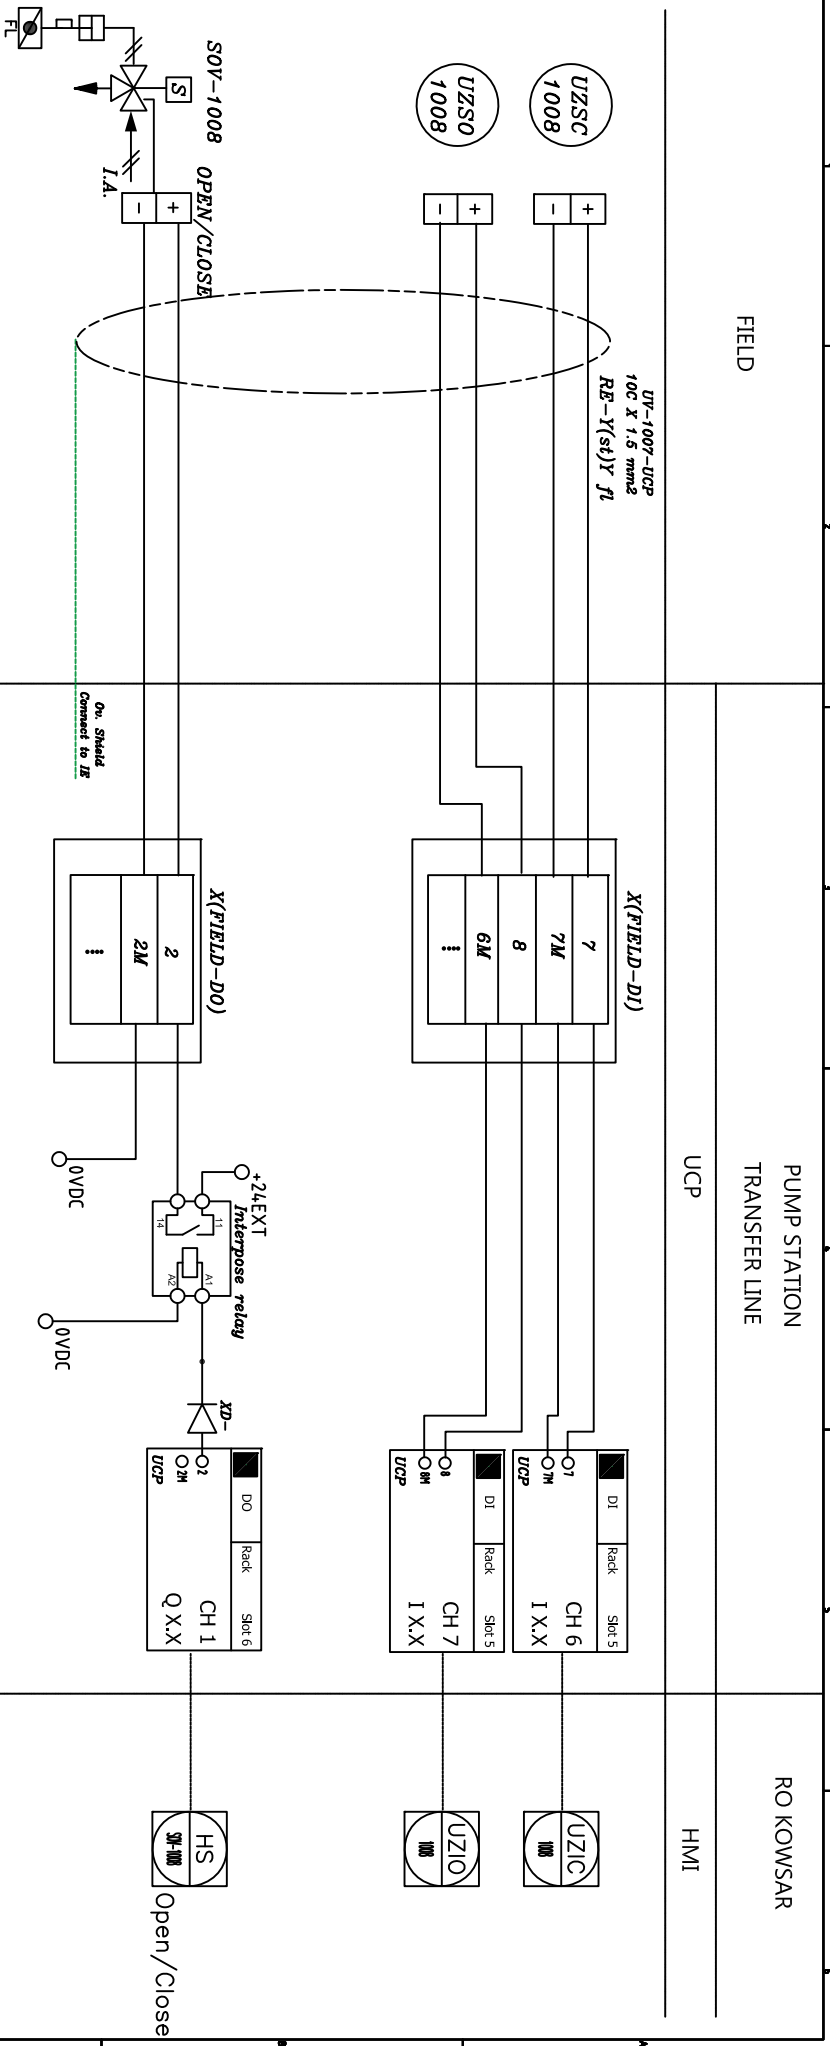


INSTRUMENT EARTH BAR
IE


[illegible]

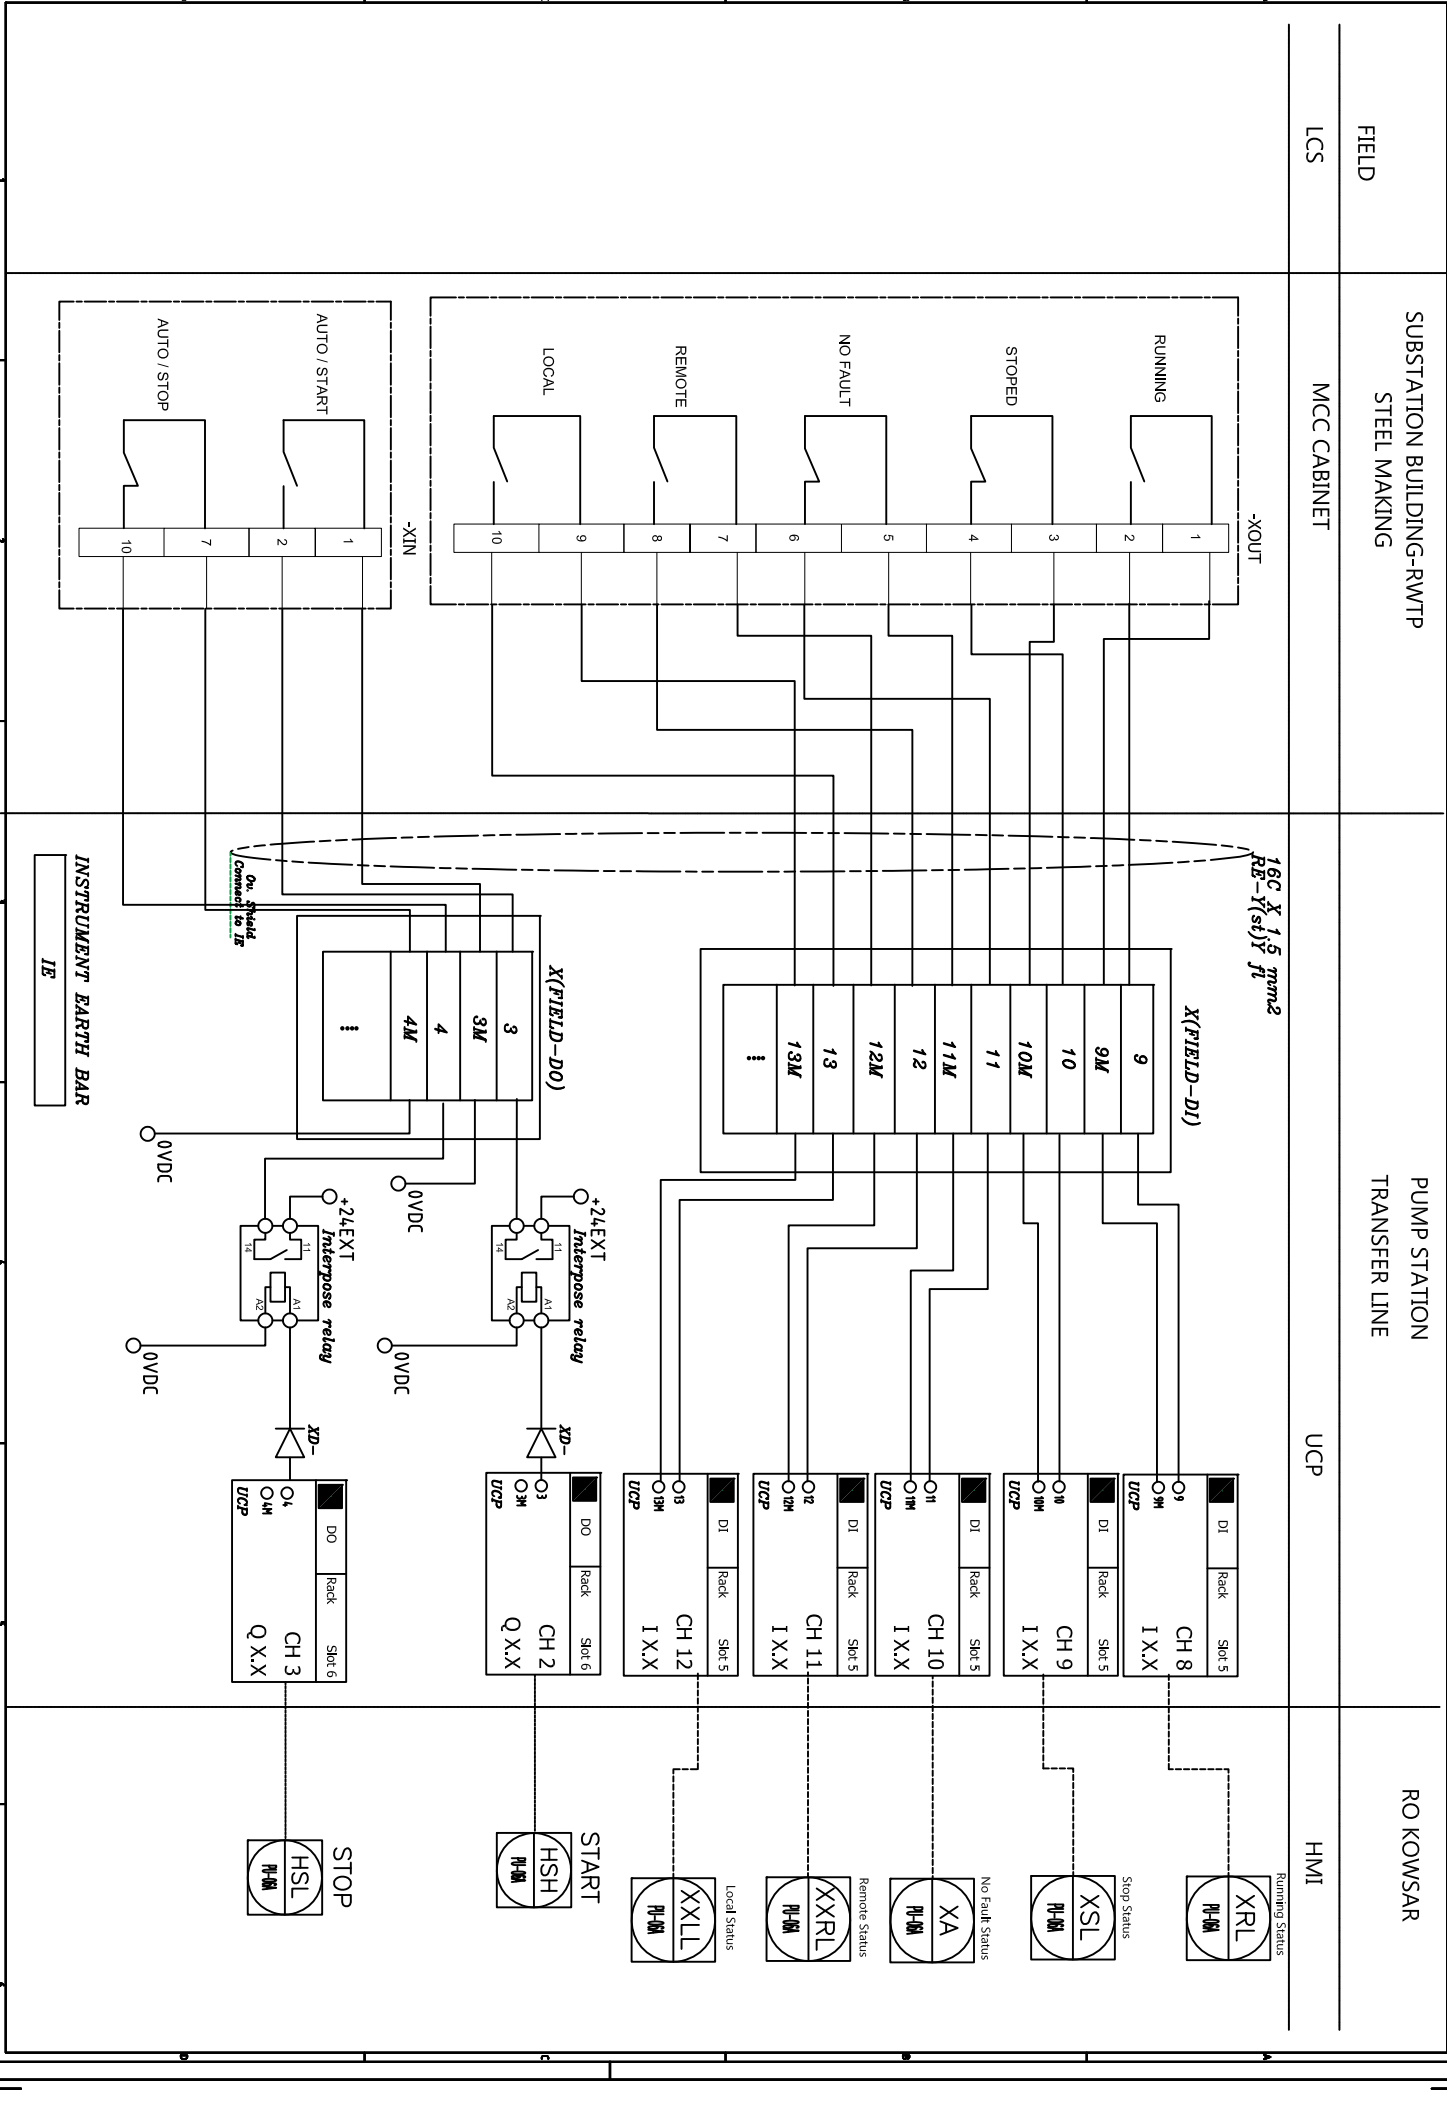


FIELD	SUBSTATION BUILDING-RWTP STEEL MAKING		PUMP STATION TRANSFER LINE	
LCS	MCC CABINET		UCP	HMI

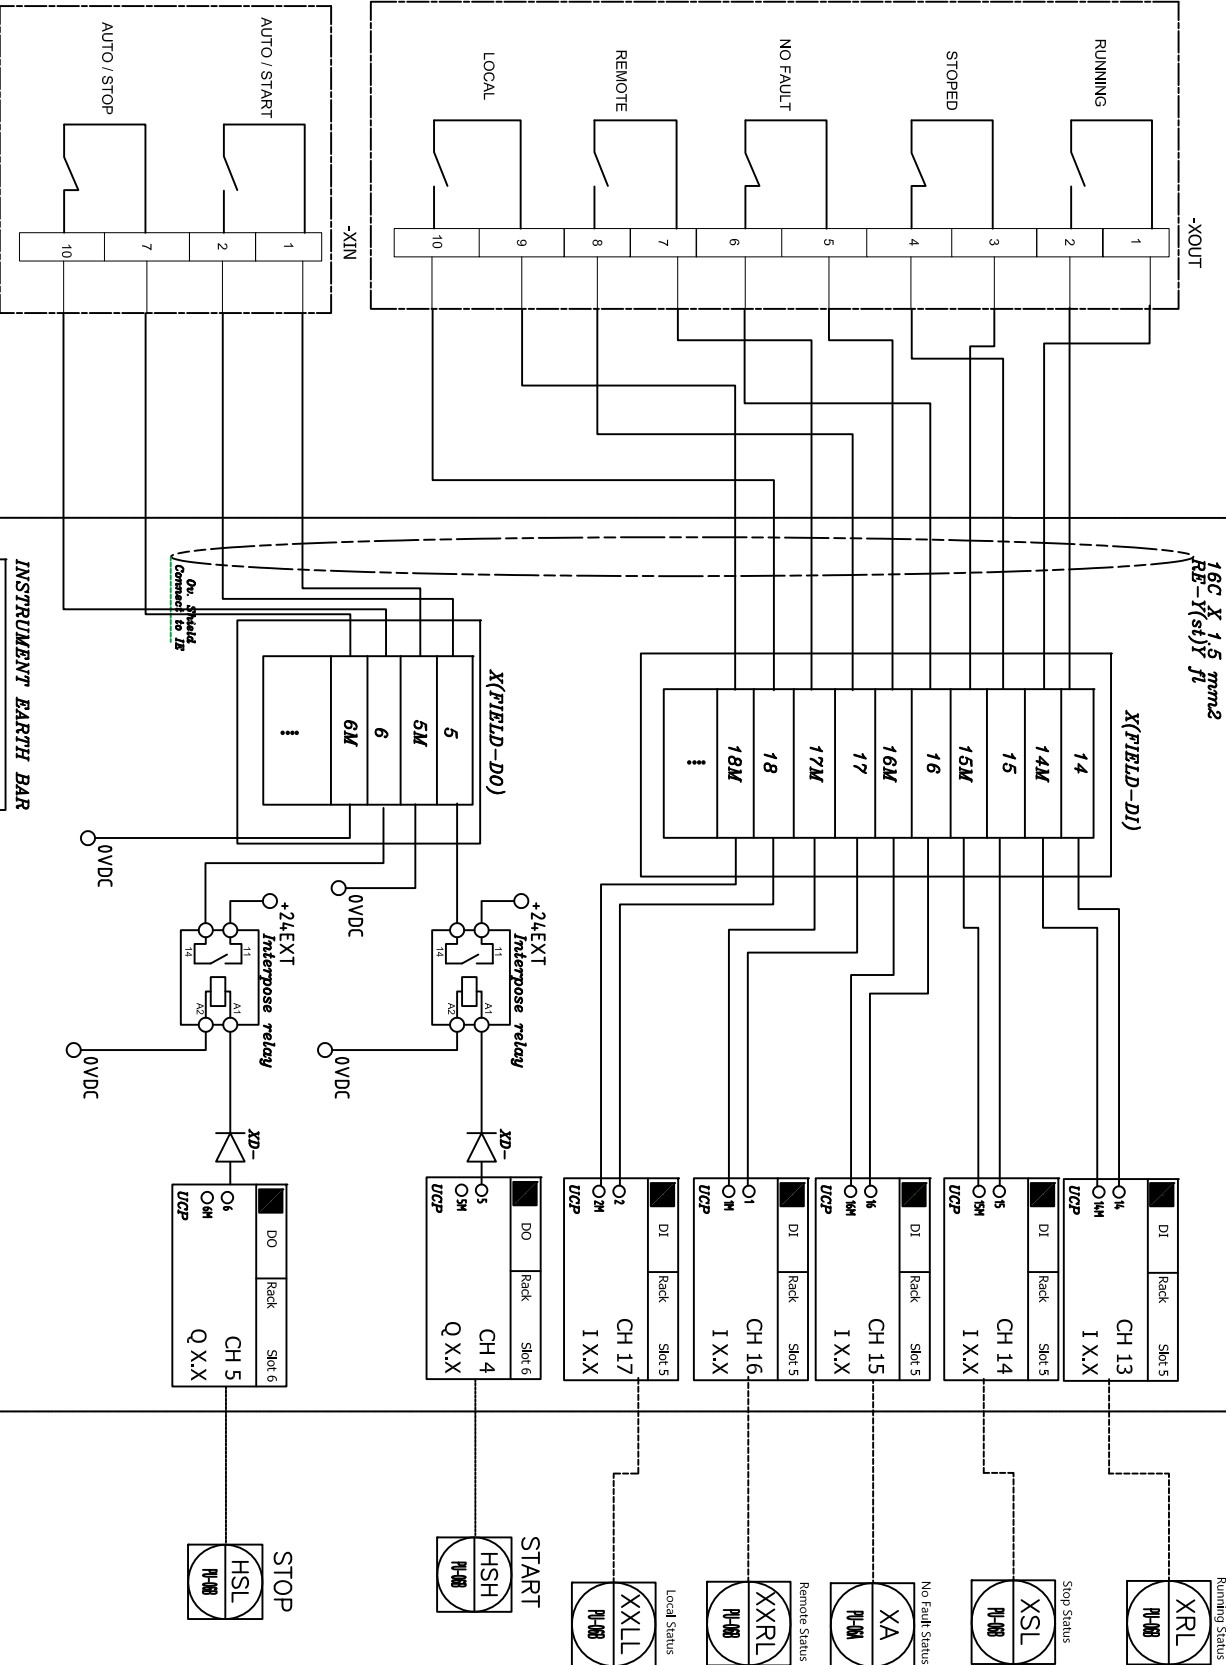

INSTRUMENT EARTH BAR
IB

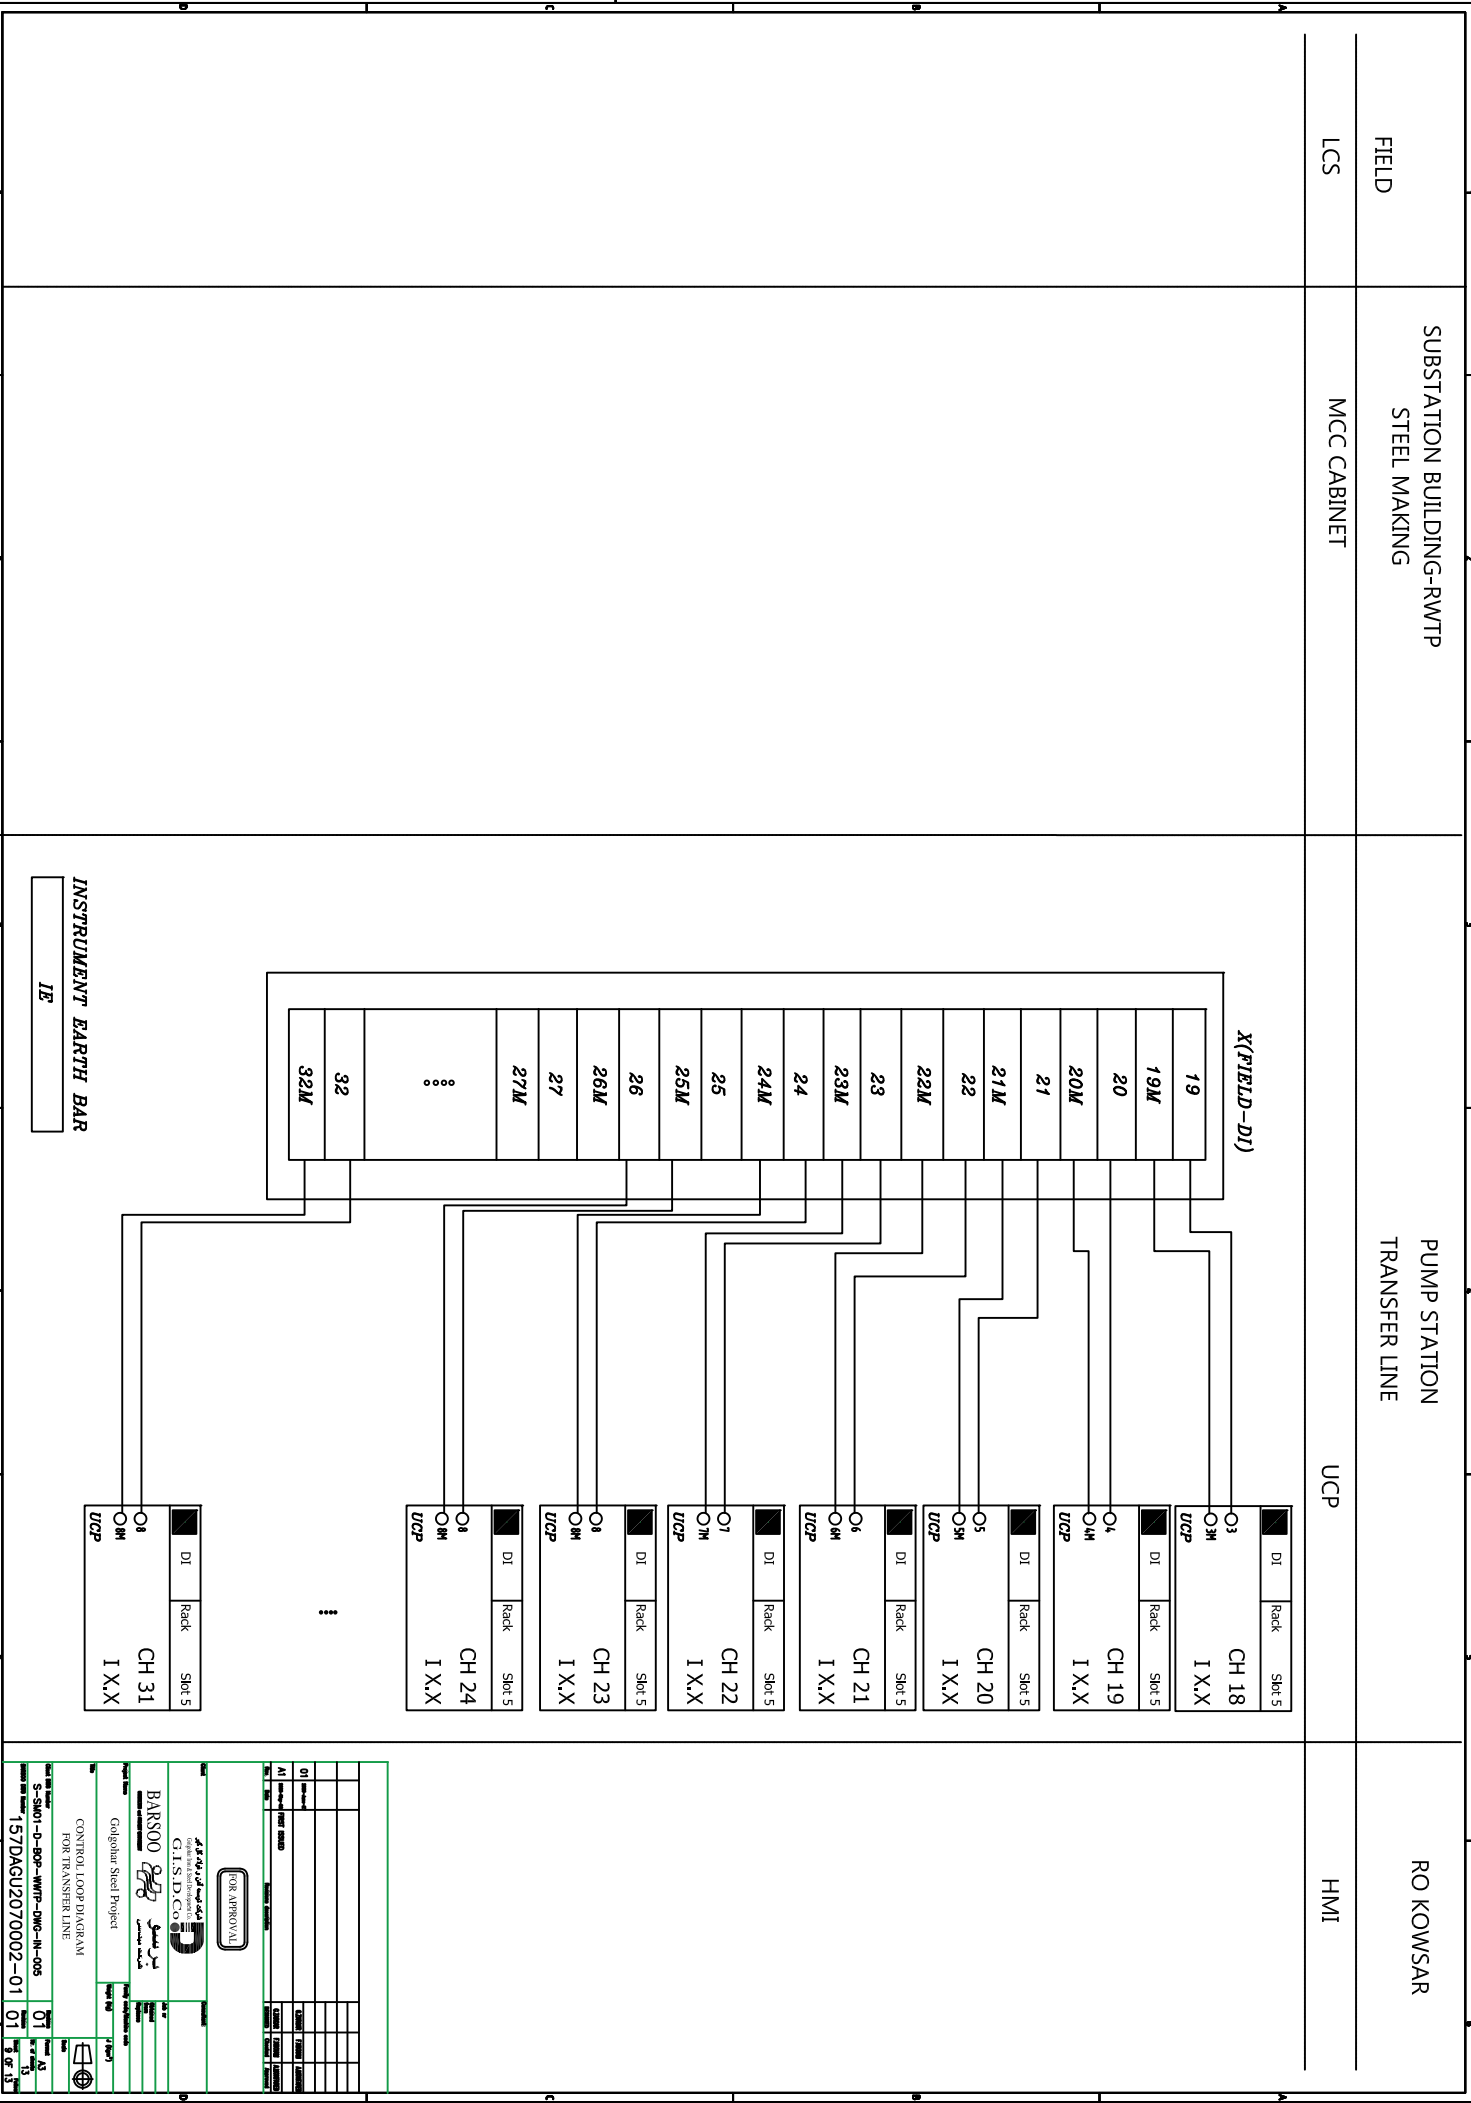

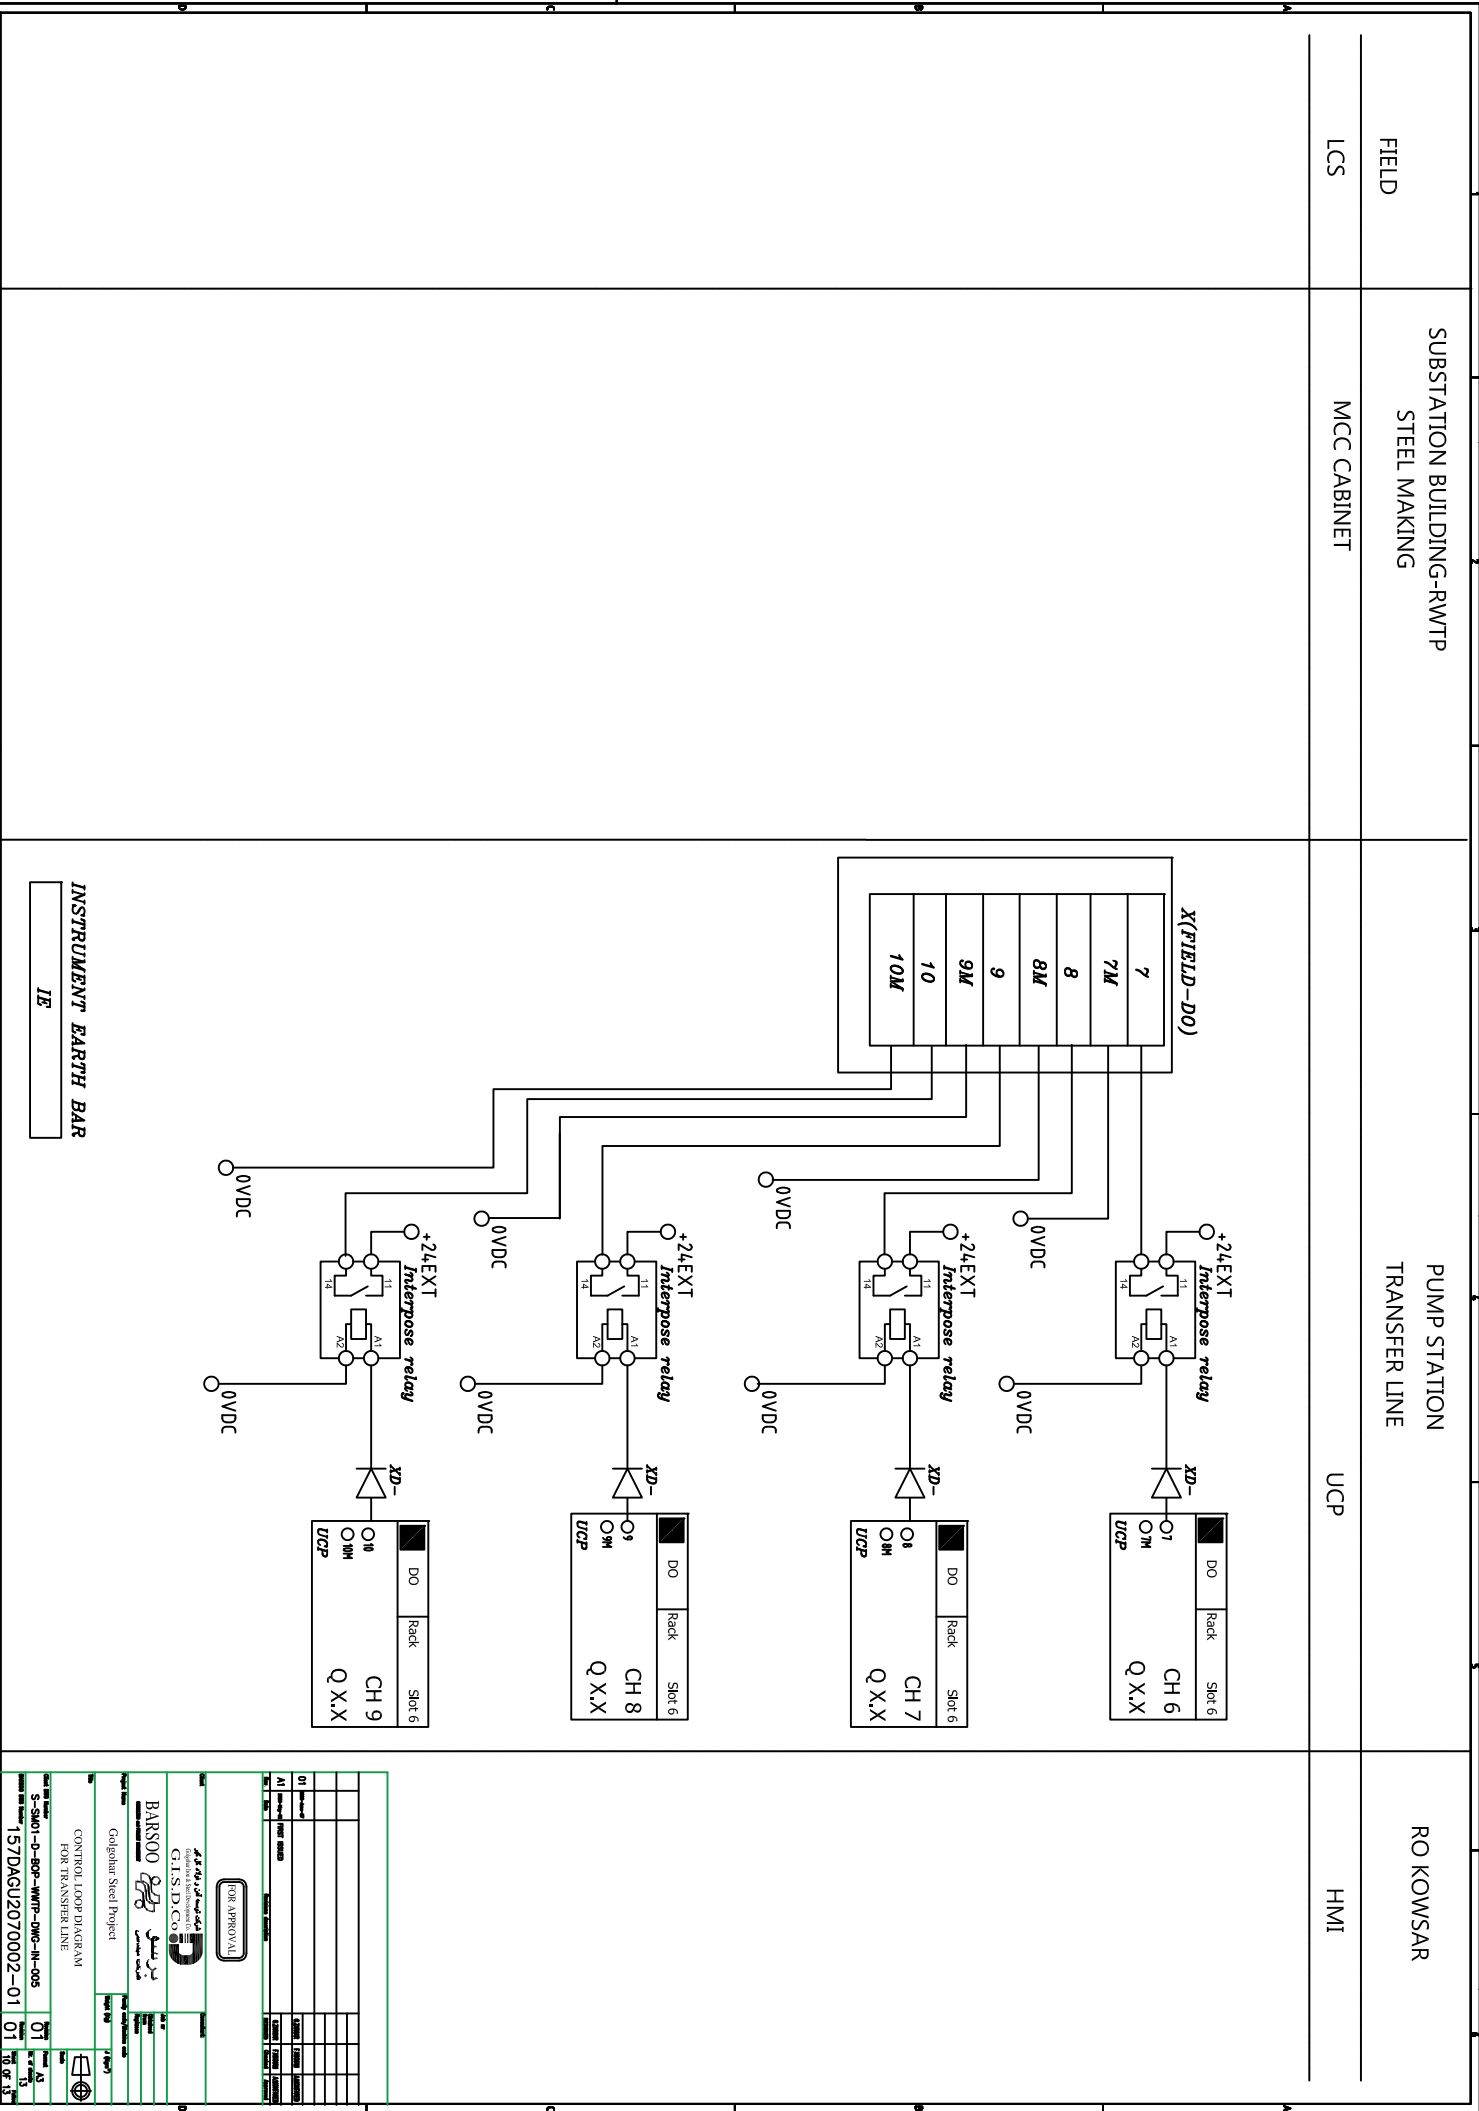


RO KOWSAR

FIELD

PLC ROOM

HMI

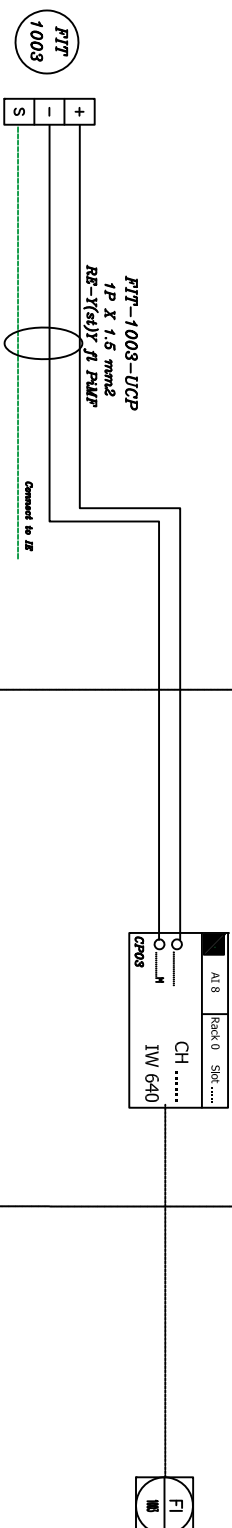

NOTE:
PT-1003 is a 4-wire electromagnetic flowmeter with separate 24VDC power supply.

[illegible]