


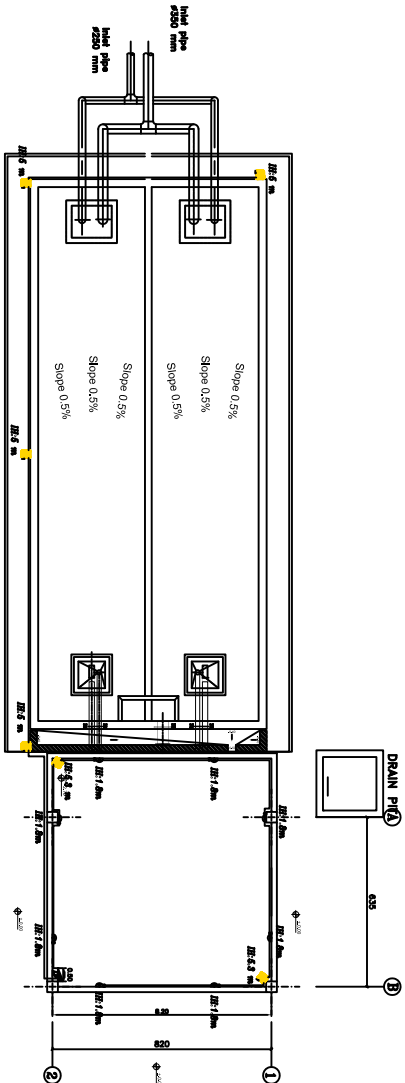


SYMBOL	DESCRIPTION	UNIT	QTY
	ELECTRICAL DISTRIBUTION PANEL, WALL MOUNTED IP44	No.	1
	SOCKET 16A/250V, 1000mm x 1000mm, 1000mm x 1000mm	No.	8
	OPTICAL 2 1000mm x 1000mm LED suspended, fixed light, 1000mm x 1000mm, 1000mm x 1000mm	No.	6
	MTT CABLE IN CONDUITS 2x16mm	m	HOLD

- 1- THE PANELS SHALL BE INSTALLED ON THE WALL AT 1.4m FROM FINISHED FLOOR LEVEL.
- 2- ALL WIRING SHALL BE INSTALLED IN THE WALLS AND CEILING.
- 3- THE CABLES & CABLES TYPE, RATING, TO STAND LINE DURING MOUNTING.
- 4- CONDUITS USED IN PLATE CEILING & PLATE MOUNTED CONDUITS SHALL BE PVC.
- 5- STORAGE MOUNTED CONDUITS SHALL BE HOT DIP GALVANIZED STEEL CONDUIT.
- 6- ANY INTERFERENCE BETWEEN LIGHTING FIXTURES & OTHER EQUIPMENTS (SUCH AS AIR CHILL, EXHAUST FAN, OPENING, FIRE DETECTOR, etc.) SHALL BE MODIFIED DURING INSTALLATION AT SITE.
- 7- ALL LIGHTING SHALL BE CONNECTED TO BATH STREET.
- 8- ALL LIGHTING CABLE AND SOCKET SHALL BE CONNECTED TO BATH STREET.

REFERENCES

NOTE

KEY PLAN

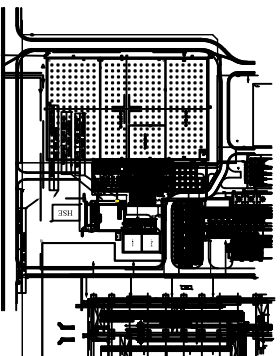

Rev.	Description	Issued	Revised	Checked	Approved
00	05.01.20	PROJECT ISSUED			

FOR REVIEW

BARSOO

Original from & Steel International Co.

G.I.S.D.CO

Project Name

Colgohar Steel Project

Scale

1:100

PUMP STATION LIGHTING SYSTEM LAYOUT FOR TRANSFER LINE

Sheet No.	00	Project No.	157DEDG1510001
Sheet No.	00	Project No.	157DEDG1510001
Sheet No.	00	Project No.	157DEDG1510001