
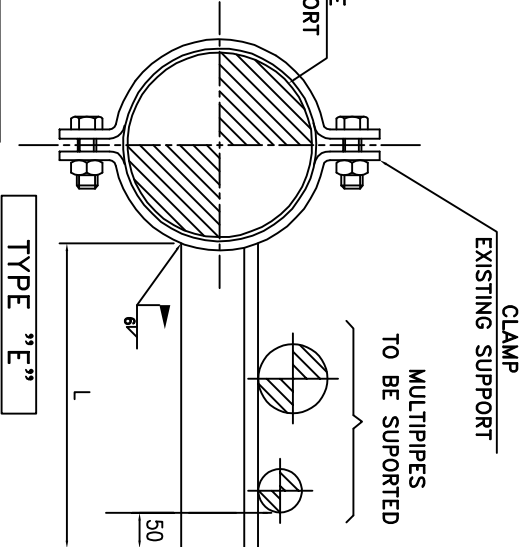
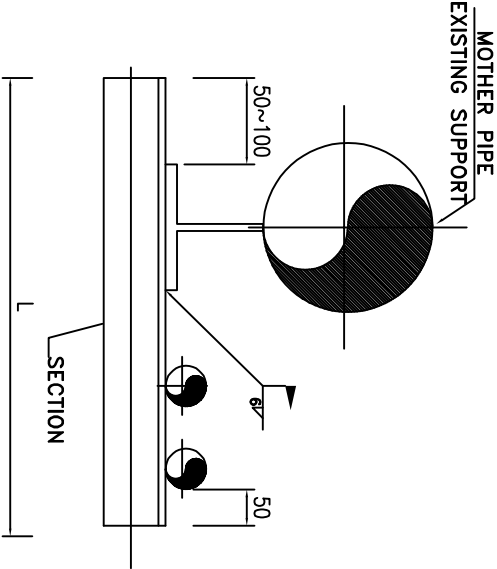
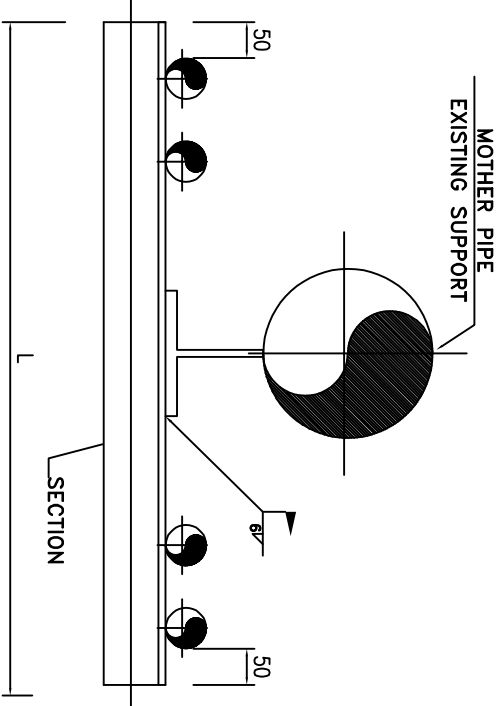


- 1-SEPARATED TAG IS REQUIRED FOR U-BOLT AND LOCATION OF U-BOLT SHALL BE ADJUSTED AT FIELD.
- 2-SEPARATED TAG IS REQUIRED FOR SHOE.
- 3-THE MAXIMUM QUANTITY OF PIPE WHICH CAN BE SUPPORTED SHALL BE CHECKED WITH ALLOWABLE LOAD.
- 4-ALLOWABLE LOADS ARE CALCULATED JUST FOR ANGLE. ALLOWABLE LOADS OF U-BOLT OR SHOE SHALL BE CHECKED SEPARATELY.

SG-02- - - - - (1) (2) (3)

- 1- ITEM TYPE
- 2- ITEM MARK
- 3- LENGTH MARK

LENGTH MARK	
MARK	L
02	200
03	300
04	400
05	500
06	600
07	700
08	800
09	900
10	1000
11	1100
12	1200
13	1300
14	1400
15	1500

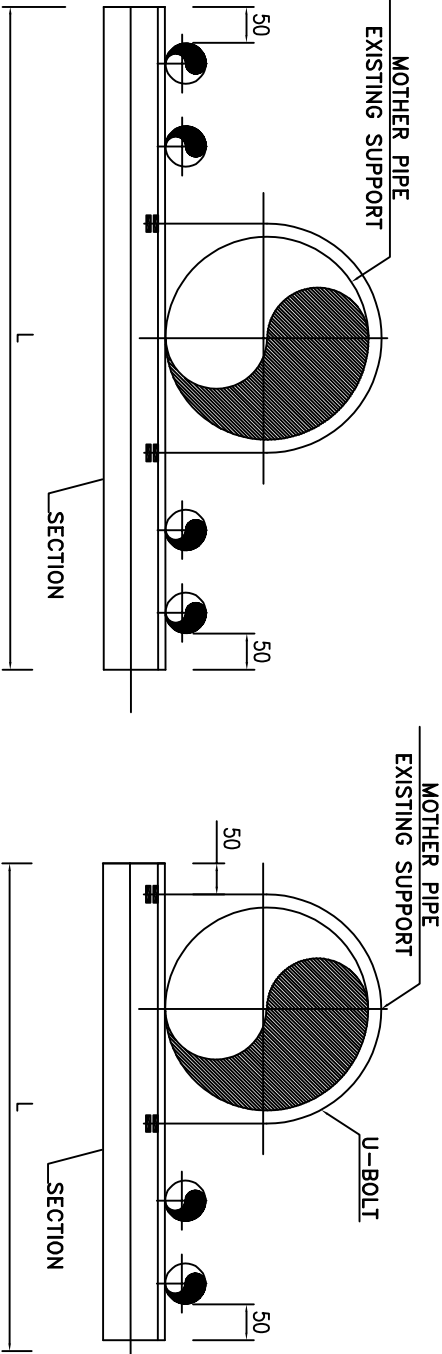

ITEM MARK	SECTION	ALLOW. LOAD(KG)-FV TYPE A		ALLOW. LOAD(KG)-FV TYPE "B","C" & "D"	
		L<1000	L>1000	L<1000	L>1000
01	ANGLE 50X50X5	220	150	50	30
02	ANGLE 70X70X7	600	400	150	100
03	ANGLE 80X80X8	900	600	230	150
04	ANGLE 100X100X10	1600	1100	450	300

DRAWING TITLE:

STANDARD FOR PIPE SUPPORT DRAWING

Contract No.	Document No.	Class	Rev.	Size	Scale	Sheet No.

00	5.6.2024	ISSUED FOR REVIEW	F.NoordinMajid	M.AH	L.ZeyidMadi	
Rev.	Date	PURPOSE OF ISSUE	Prepared	Checked	Approved	Authordad

COMPANY:

شركة توسعة آبن و فوال كل كهر

G.I.S.D.Co.

GISDCo.

INTERNAL PROCEDURE