

NOTES

- 1-DIMENSION "H" CAN BE ADJUSTED AT FIELD.
- 2- THE MAXIMUM QUANTITY OF PIPE WHICH CAN BE SUPPORTED SHALL BE CHECKED WITH ALLOWABLE LOAD.

SE-09-

(1)


(2)

(3)


(4)

- 1- TYPE MARK
- 2- ITEM MARK
- 3- LENGTH MARK
- 4- HEIGHT MARK


LENGTH & HEIGHT MARK	
MARK	L
02	200
03	300
04	400
05	500
06	600
07	700
08	800
09	900
10	1000
11	1100
12	1200
13	1300
14	1400
15	1500

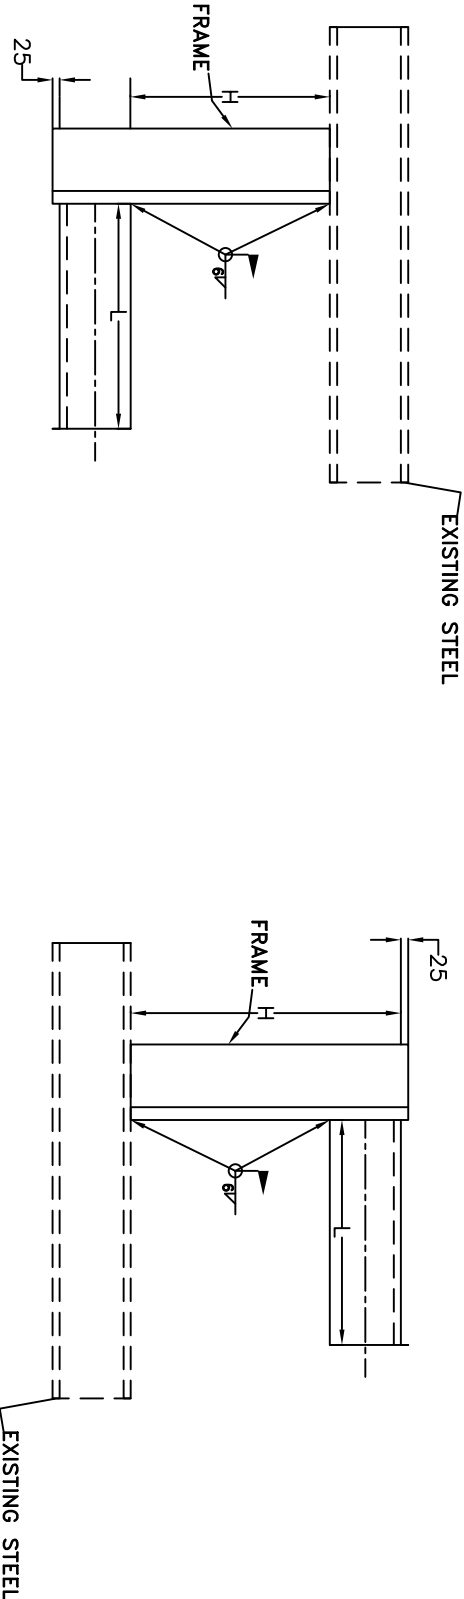

TYPE "A"

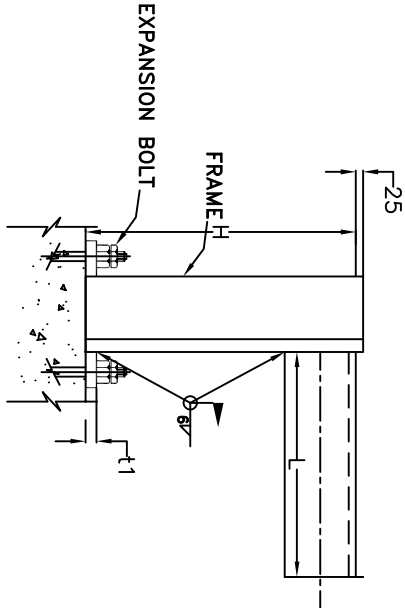

TYPE "B"

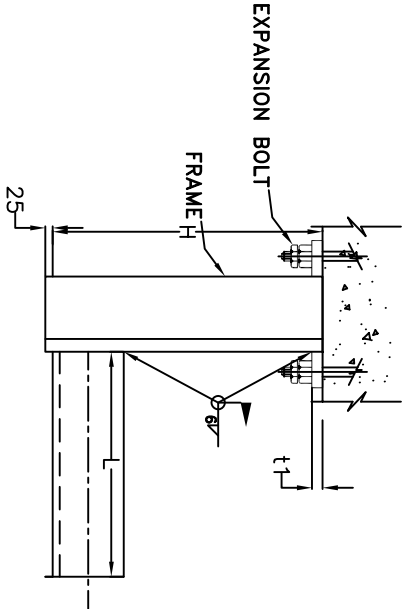

TYPE "C"


TYPE "D"

ITEM MARK	MEMBER	L	H	ALLOWABLE LOAD(KG)	ITEM	MEMBER	L	H	ALLOWABLE LOAD(KG)
01	ANGLE 50X50X5	400	300<H<900	70	04	CHANNEL 180	550	500<H<1100	1100
		550		50			700		1000
		700		40			850		900
02	ANGLE 70X70X7	500	300<H<900	140	05	HEB-140	500	600<H<1200	2800
		650		110			700		2000
		800		90			900		1600
03	CHANNEL 140	450	400<H<1000	800	06	HEB-180	600	600<H<1200	3900
		600		750			800		3000
		800		700			1000		2400

FRAME	EXPANSION BOLT	t1
ANGLE 50X50X5	M 16X163	10
ANGLE 70X70X7	M 16X163	10
CHANNEL 140	M 16X163	12
CHANNEL 180	M 16X163	12
HEB-140	M 20X190	20
HEB-180	M 20X190	20

00	5.8.2024	ISSUED FOR REVIEW	F.No:01/04/2024	M.A.H	L.Zeydovadi
Rev.	Date	PURPOSE OF ISSUE	Prepared	Checked	Approved
					Authorized

COMPANY:



شرکت توسعه آهن و فولاد گل گهر
G.I.S.D.Co.

GISDCo.

INTERNAL PROCEDURE

DRAWING TITLE:

STANDARD FOR PIPE SUPPORT DRAWING

Contract No.	Document No.	Class	Rev.	Size	Scale	Sheet No.